



proposed rear elevation

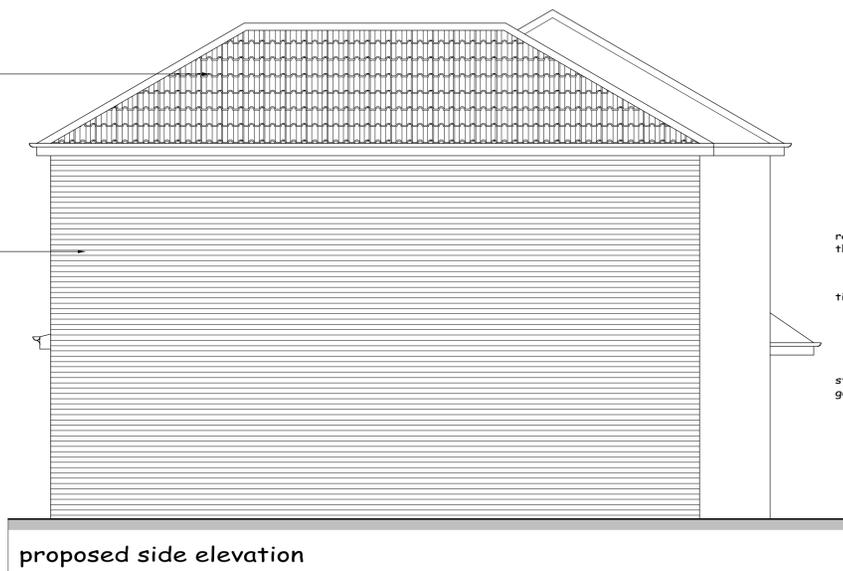

proposed side elevation

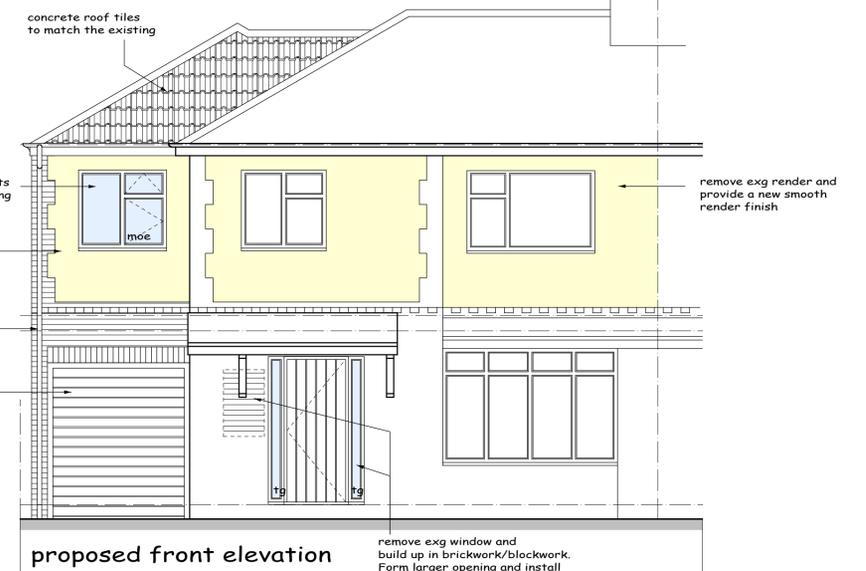

proposed front elevation

Foundations:
600 x 600mm concrete trench fill taken down to firm bearing strata at min 900mm below ground level. Foundations to be taken down to invert of any drain within 1000mm of excavation.

Ground Floor Construction Main:
18mm asphalt screed on 100mm concrete slab on visqueen 110mm Celotex XR4000 or equivalent floor insulation on 1200 gauge DPM lapped into DPC on 25mm sand blinding on consolidated hardcore. Provide 25mm ridged insulation to the edge of slab. Provide 100mm dia duct pipe through to air bricks with cavity trays over to vent any exg air bricks.

Drainage:
New drains bridged where passing through footings. Drains passing under building to be encased in 150mm concrete. All new drainage to be 100mm diameter Polypipe Underground or similar drainage system. Pipes laid to self clearing fall on 150 bed pea shingle. New gullies to be roddable NB Drainage systems to be checked on site to determine - combined or separate systems - if separate ensure foul and surface water are connected to correct drainage system.

Flashings:
Code 4 lead stepped and straight flashings with DPC cavity trays over at all abutments.

Heating:
Mode of heating to extension as yet unknown if a new boiler to be fitted this is to have a Class A SEDBUK energy efficiency rating. NB All plumbing work to be carried out by GAS SAFE registered installer Hot water & heating systems to comply with Domestic Heating Compliance guide.

External Walls traditional:
100mm brickwork outer leaf to match existing 50mm air gap with 50mm celotex CW4000 insulation to the cavity - 100mm thermalite black inner leaf dry lined in 9.5mm plasterboard and skim on Drywall dabs. Stainless steel double triangle wall ties (min 59mm embedment) 750mm horizontal c/c & 450 vertical c/c staggered and doubled up at all window and door reveals. Cavities to be closed at all reveals and at eaves - using Thermabate insulated cavity closers. NB all masonry below ground level to be in concrete common brick. DPC to be fixed at min 150mm above ground level. Provide cavity fill to 225mm below damp proof course.

Doors and Windows:
All new windows to be double glazed and have trickle vents not less than 8000mm². All windows joining a door or a glazed door or less than 800mm above floor to be in toughened glass to BS6206 or EN11215D. New and replacement windows and roof lights fully draught proofed & double glazed in Optiwhite (outer pane) 16mm argon filled air space with aluminium spacer bar with an inner pane of low emissivity 'k' glass to give a 'U' value of 1.6w/m² or window energy rating band C certificates of compliance to be provided to building control on completion. New windows to habitable rooms without alternative at least 1no opening light with a clear opening of 450 x 750mm. Top hung Windows to have assist arms and stays to keep up.

Primary and secondary heating systems (new and replacement installations)

Primary - main heating and hot water system e.g. main boiler; secondary - localised heating provisions e.g. gas fire/ solid fuel fire / stoves. Both types of appliances efficiency and controls, whether as a new installation or replacement for an existing system must be designed, installed and commissioned in strict accordance the 'Building Services Compliance Guide' published by the department for communities and Local Government. You are advised to check with the boiler manufacturer as to the appropriate controls to be used to achieve Approved Document L1 compliance to avoid system problems. (see appropriate extract) Requirements for certain gas and Solid Fuel Appliances are included below - for systems not covered fully comply with the 'Building Services Compliance Guide'. (Available on TMBC's Building Control Web Page) Any new gas boiler to be minimum 90% SEDBUK Condensing wall mounted with balanced flue/stainless steel guard to outlet.


Lighting (Energy Saving Provisions)
To any new wiring system or when REWIRING an existing lighting system - install energy efficient light fittings as follows. (NOTE: Fluorescent or compact fluorescent light fittings meet this standard. GLS Tungsten lamps with bayonet caps or screw bases or Tungsten halogen lamps are not acceptable):
Fixed Internal Lighting: Install energy efficient light fittings that only take lamps having a luminous efficacy greater than 45 lumens per circuit-watt (power consumed) and a total output greater than 400 lamp lumens. Light fittings with supplied power less than 5 circuit-watts are excluded from the overall count of total light fittings below: i.e. pin base fitting only to ensure only energy efficient fittings can be replaced. Provisions: Not less than 3 per four of ALL the light fittings in the main dwelling spaces (excluding infrequent lit accessed storage spaces and cupboards).
NOTES:
a) Be careful when considering the use of mains frequency fluorescent lighting in garages, as they can cause strobing issues with machine tools and vehicles.
Fixed External Lighting (Excludes flats common areas and other communal access-way lighting):
Provisions:
a) EITHER: lamp capacity not to exceed 100 watts per light fitting and fitting to have automatically daylight and motion sensor fitted or
b) Fittings to have sockets capable of only using lamps with an efficacy greater than 45 lumens per circuit-watt fitted with automatic daylight sensors and must be switched controlled.

Ventilation:
Unless otherwise stated, room ventilation will be provided by natural means. Windows to incorporate: opening lights at least equal to 1/20th floor area, along with controllable trickle vents with an equivalent area of 5,000mm². Where opening restrictors are to be provided the opening lights to be increased in size to 1/10th of the room floor area. Wet room areas to be afforded mechanical extract ventilation using the following extract rates:
Kitchen 30 Litres/sec (adjacent to the hob)
60 Litres/sec elsewhere
Utility Room 30 Litres/sec
Bathroom 15 Litres/sec
Sanitary accommodation 6 Litres/sec.
In addition, controllable trickle vents with equivalent area of area of 2,500mm². All extracts to open air.

Partitions:
Partitions at ground floor level formed in 75 x 50mm studding at 400 centres with 12.5mm plasterboard and skim finish both sides. Double joists under all partitions running in direction of joists. All walls between WC & habitable rooms to have 50mm sound deadening insulation between.


Plumbing to new WC:
WC to have 100mm connection to soil pipes. basin to have 75mm deep seal anti vac trap with 32mm diameter waste. All wastes bossed on to exg soil and vent pipe.

Lower Roof Construction: Unvented Cold Roof
Concrete roof tiles on 38 x 25mm tanalised battens on Du Pont Tyvek breathable roof membrane on (for vaulted section only 19mm ply to form diaphragm (fix to underside of rafters to avoid condensation issue.) 150 x 75 rafters @ 400 centres. 100 x 50 ceiling joists @ 400 centres. 100 x 75 wall plates bedded on and strapped to blockwork @ 2000mm centres. 300mm Rockwool insulation laid in 2no layers between and across ceiling joists - pack eaves with insulation. Ceiling joists underdrawn 12.5mm plasterboard and skim. Vaulted roof section. Fix 100mm Celotex tuff R insulation tight between rafters ensuring 50mm air space is maintained over insulation. Fix 35mm Celotex insulation across rafters to eliminate cold bridging - 500 gauge visqueen vapour barrier over insulation - fix 12.5mm plasterboard through insulation to rafters using 65mm galvanized nails and finish with 3mm plaster skim.

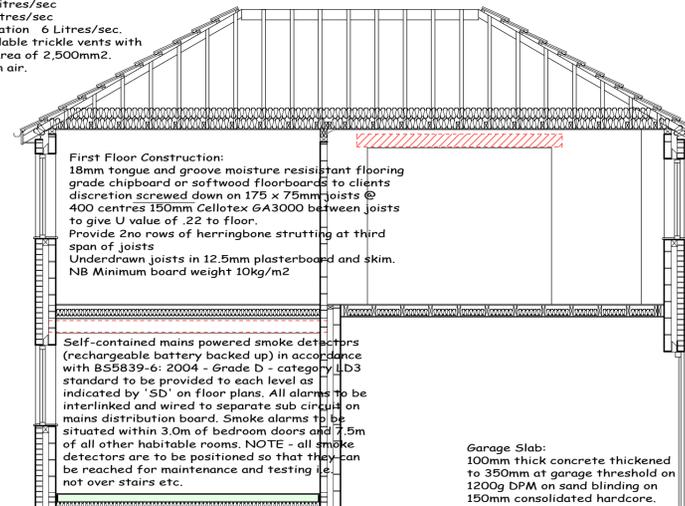


proposed section A - A


Structural Steel:
All structural steel to be encased in a minimum 18mm Gypsum plaster to give minimum half hour fire protection.

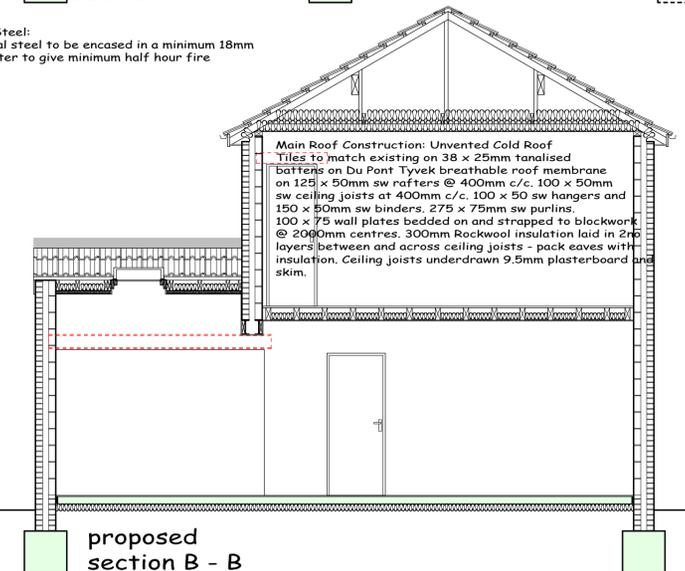

proposed section B - B

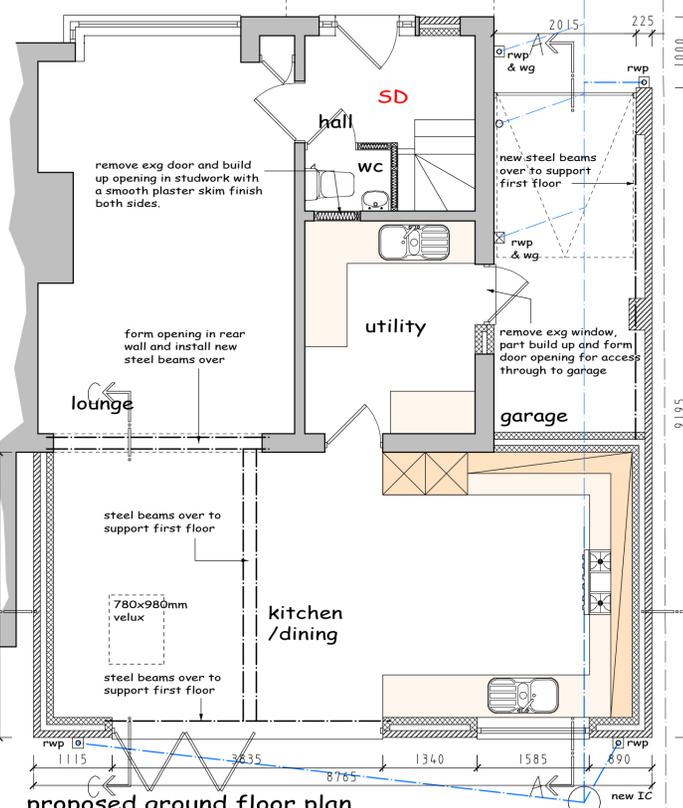

proposed ground floor plan

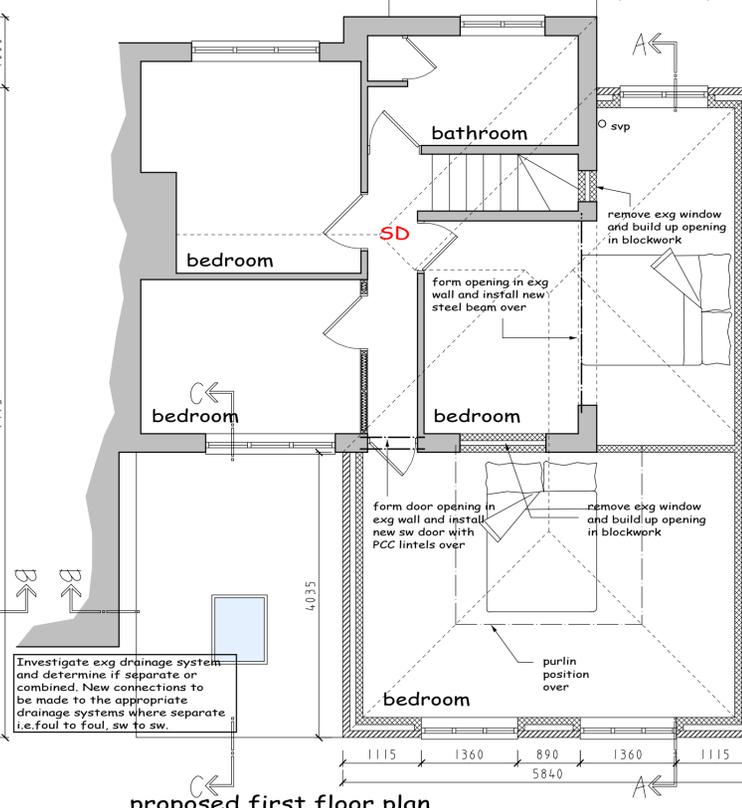

proposed first floor plan

This drawing has been prepared for the sole purpose of obtaining Planning Permission and Building Regulations Approval (DAS). All structural calculations are to be checked by structural engineer prior to construction.
All dimensions & details are to be checked on site prior to construction, any discrepancies reported to ExtensionsNW prior to any work undertaken. Any work undertaken prior to full planning & building regulation approval is at the builder's own risk. ExtensionsNW will not be held responsible for any problems arising.
This drawing is the copyright of ExtensionsNW and any reproduction in whole or part is strictly forbidden.
Printed on 02/05/2023
ExtensionsNW reserve the right to modify and make necessary alterations dependent on site conditions.

D			
C			
B			
A			
DATE			
SCALE	1:50	DATE	March 12
DRAWN	JDJ	P.P	B.R
CUSTOMER			
PROJECT			
EXTENSIONS TO SIDE AND REAR			
LOCATION			
LOCAL AUTHORITY			

Extensions NW
3 Clifton Street, Ravenhill, BBA 8BZ
Tel: 01706 23185 Mob: 0796428495
Web: www.extensionsnw.co.uk E-mail: jpc@extensionsnw.co.uk

JOB No.	
REV.	